primary layer power transformer. 17T + 17t on outer
secondary layer 12t + 12t on sec ctapped 1e24ct
accessory layer... 7t+7t center tapped 1e 14t ct



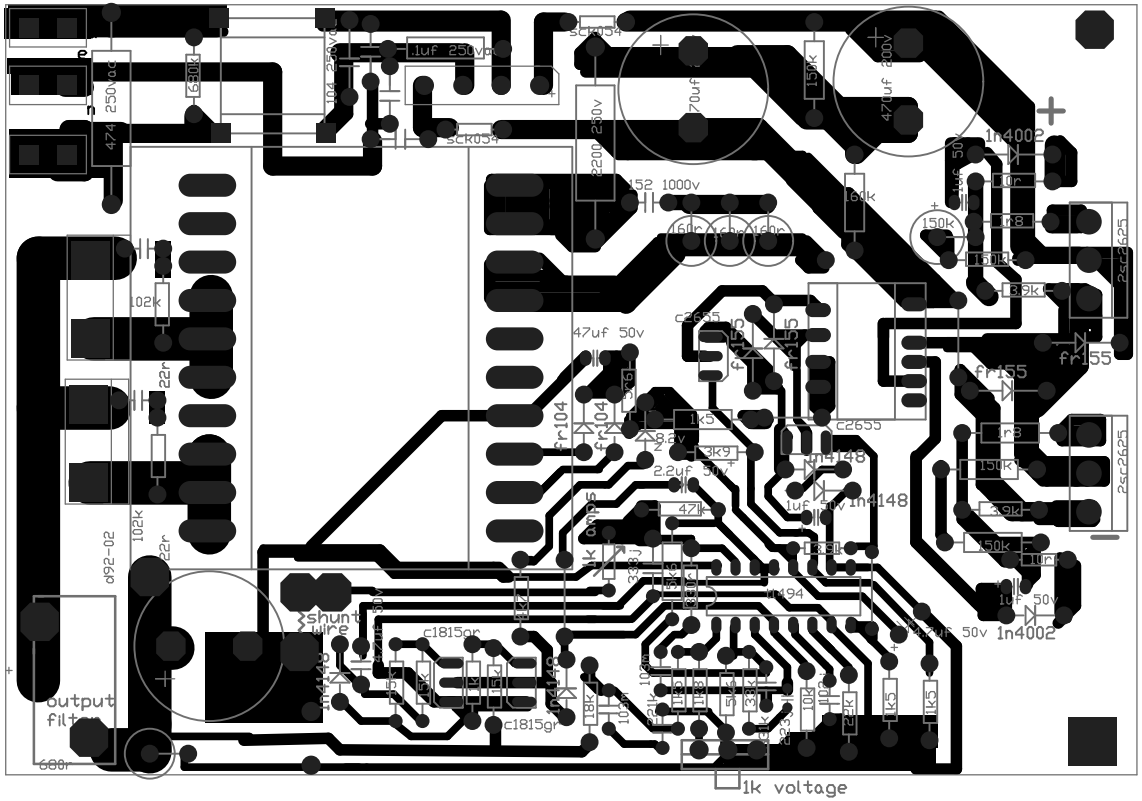

SMPS3L Check Plot